

FIG. 1

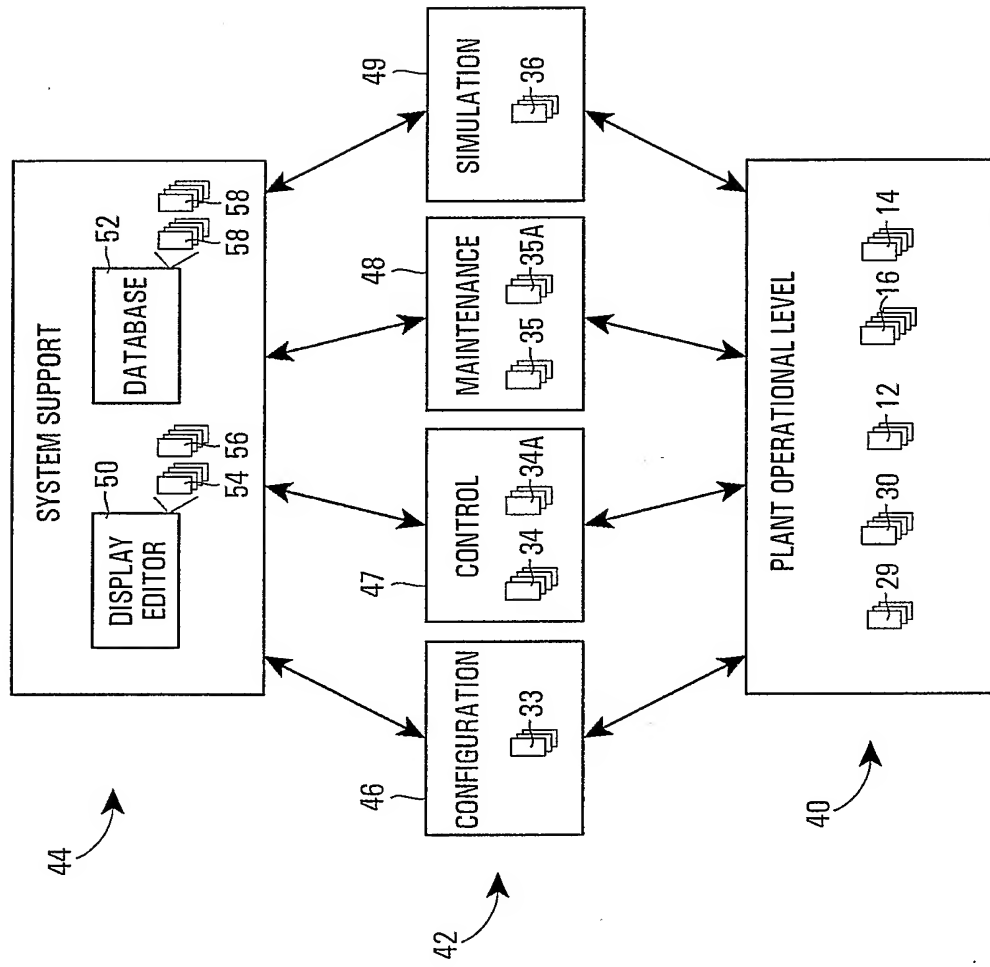


FIG. 2

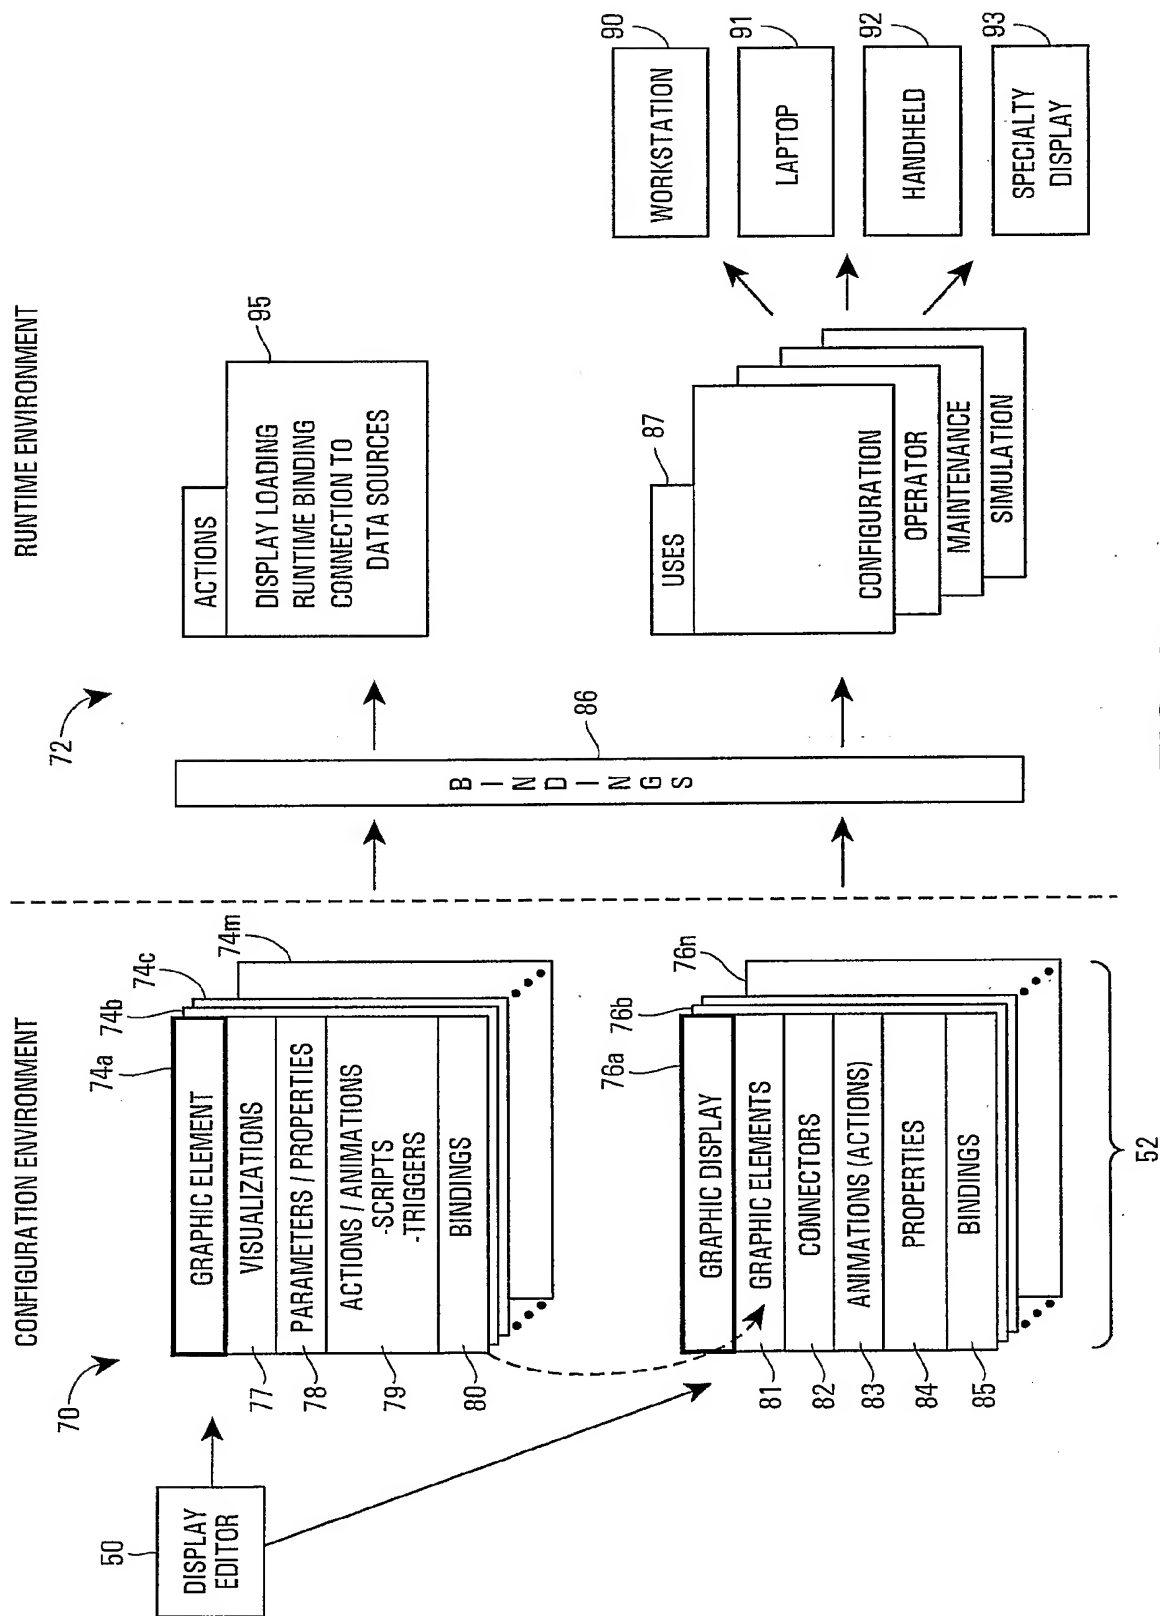


FIG. 3

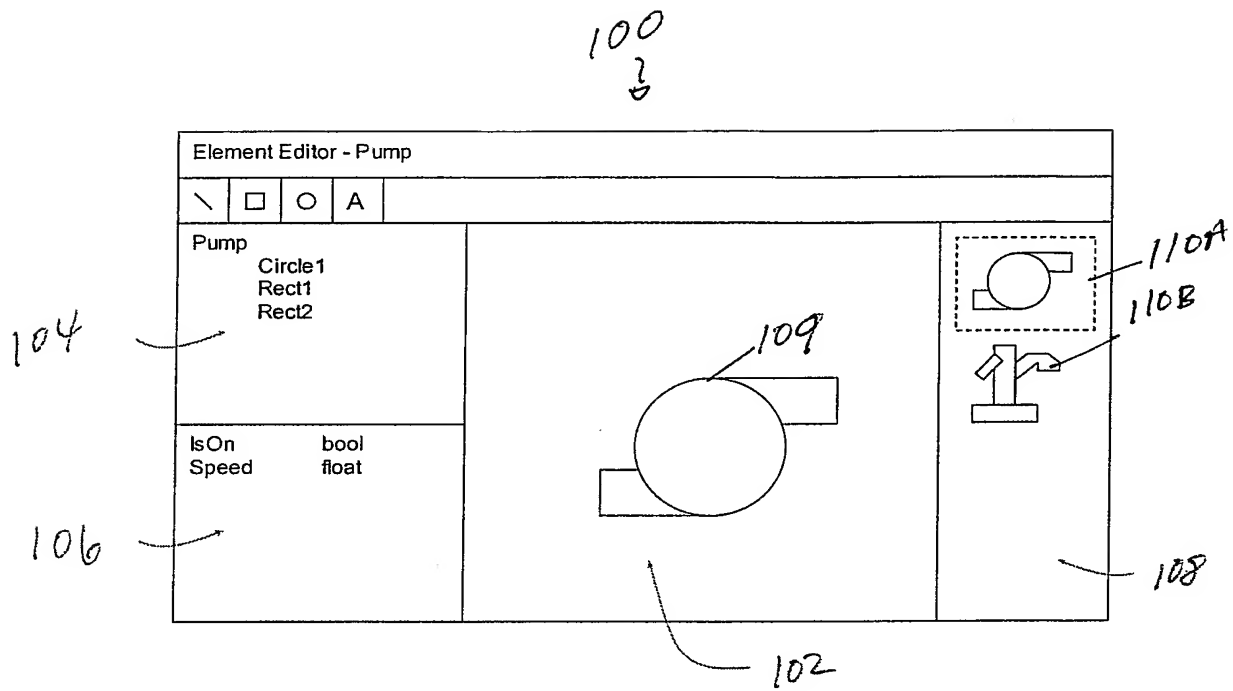


Fig. 4

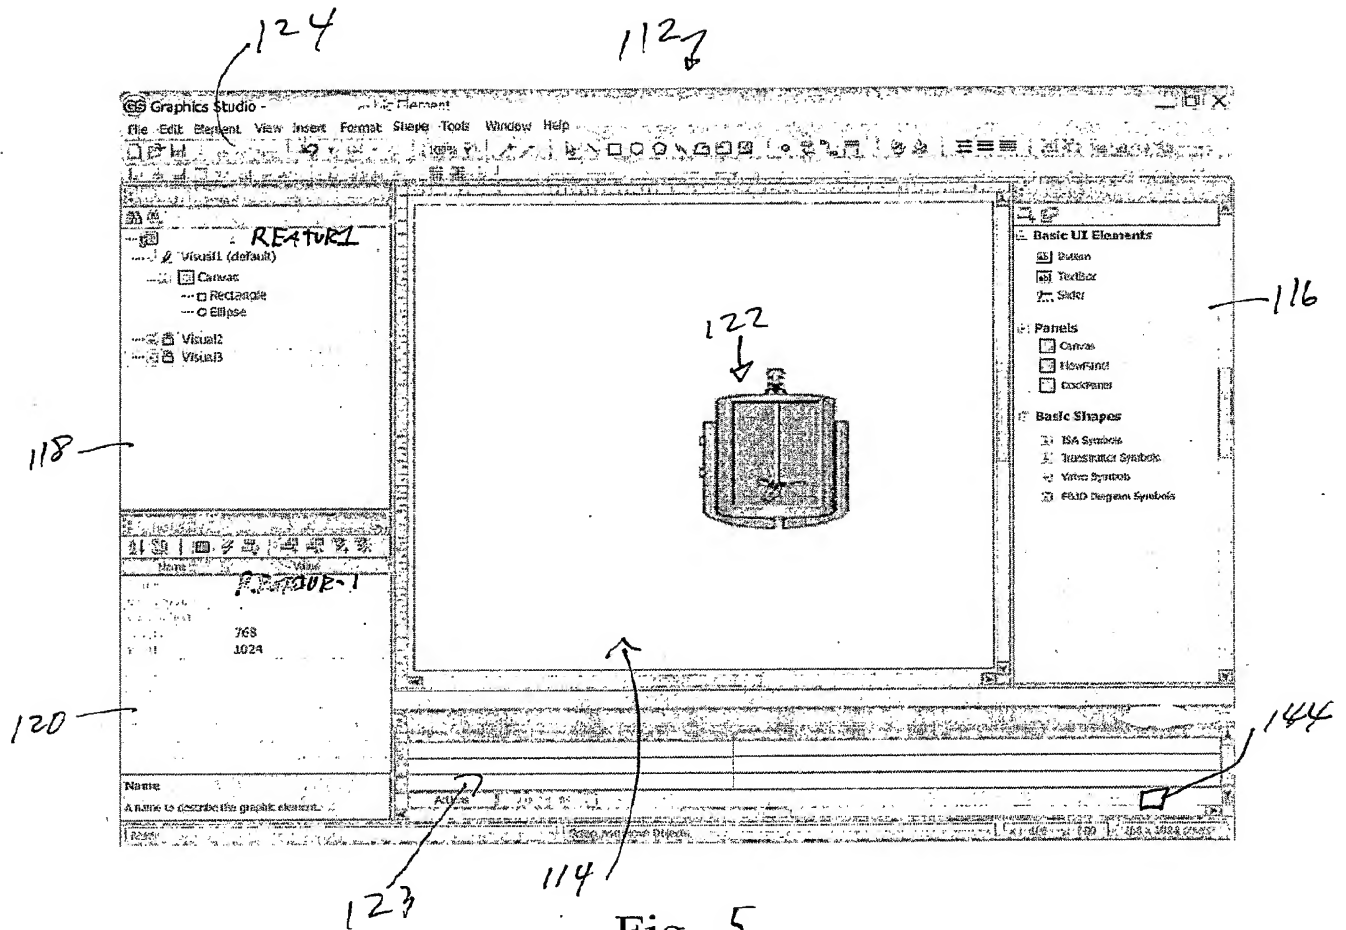
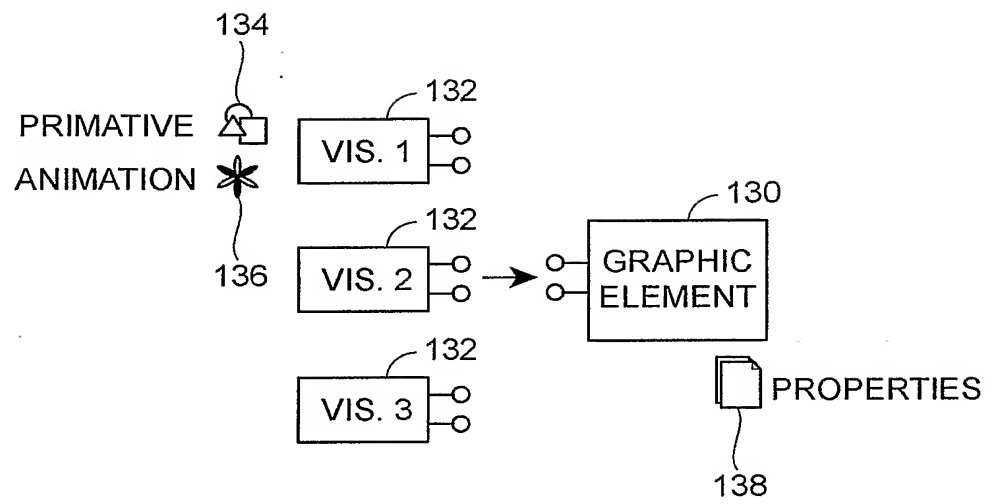


Fig. 5

**FIG. 6**

120A

Properties		
Name	Data Type	Default
IsOn	Bool	True
Speed	String	Fast

IsOn

Indicates whether the pump is on or not.

FIG. 7

120B

Pump

Name	Value	Animation	Binding
Name	1		
Background	1	<input type="checkbox"/>	Spe... <input type="checkbox"/>
Description			
Height	768		
Width	1024		

IsOn
Indicates whether the pump is on or not.

FIG. 8

123A

Element Property	Value	Target	Property	Value
IsOn	True	Visual1/Rectangle1	Fill	Red
IsOn	True	Visual1/Ellipse1	Visible	False

Adaptive Administration ☐ Show All

Fig. 9

144

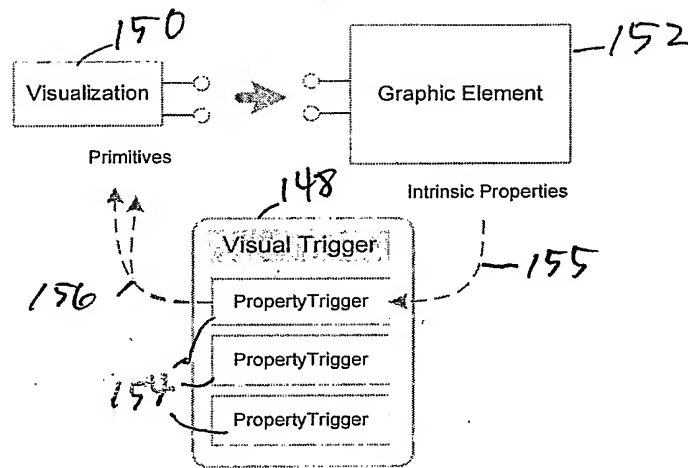


Fig. 10

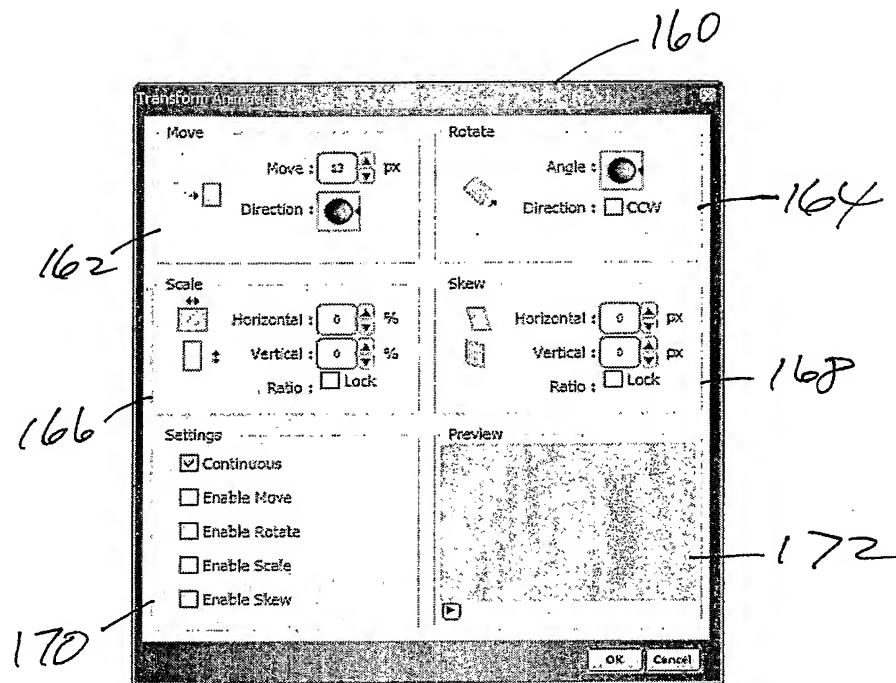


Fig. 11

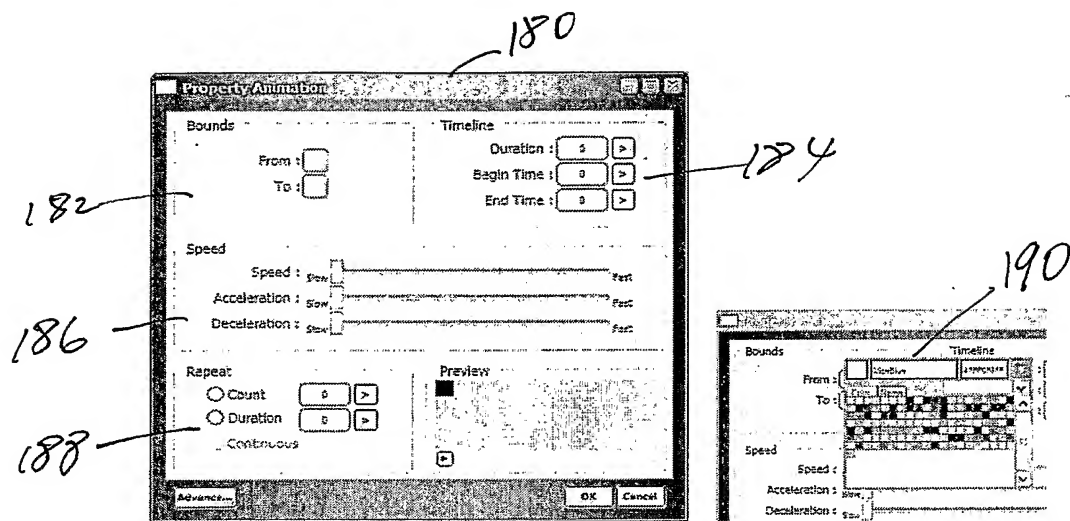
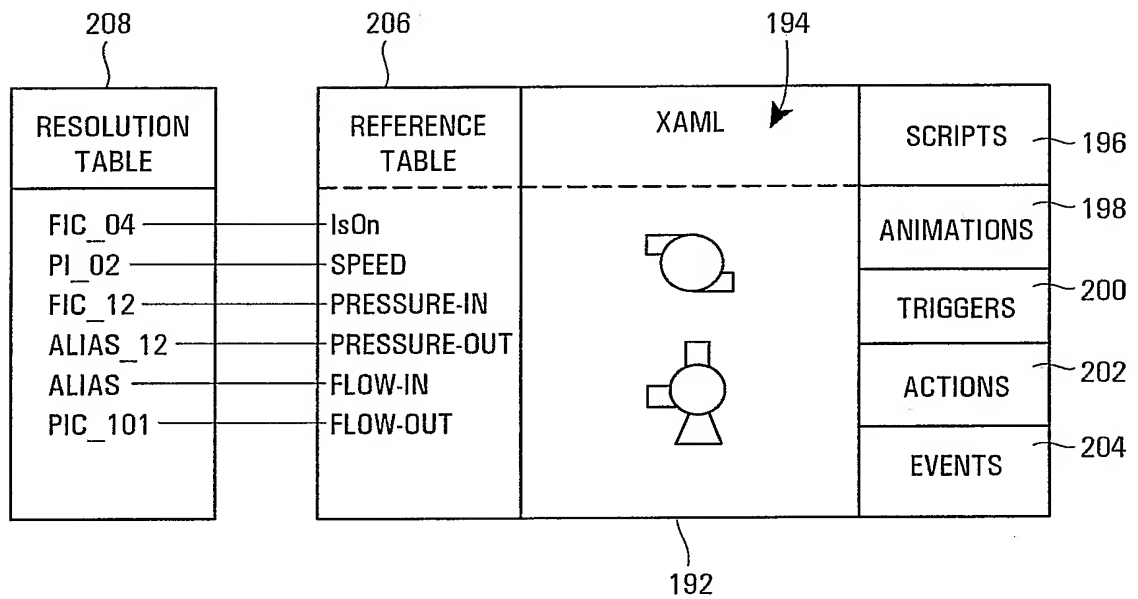
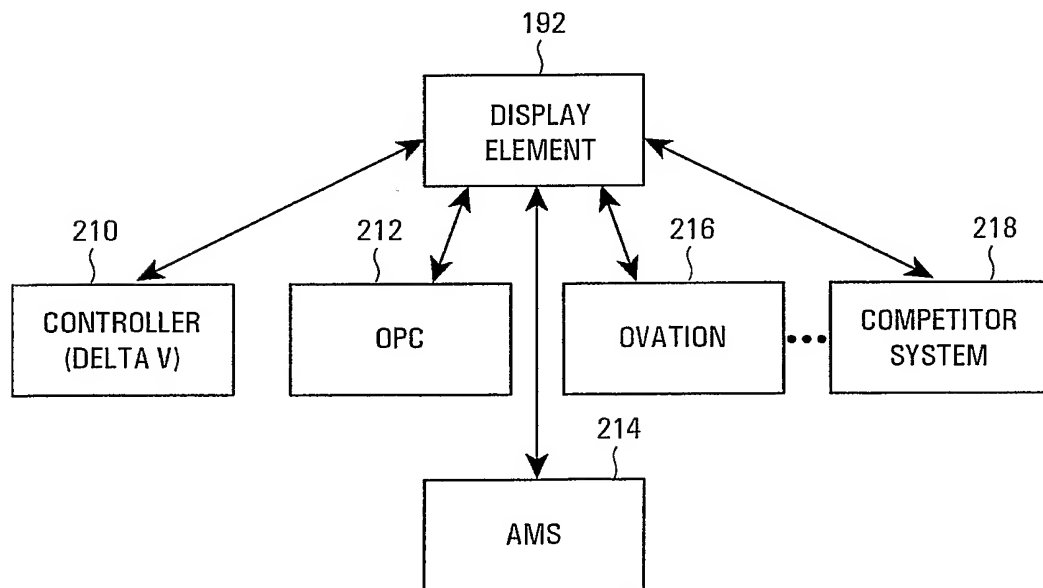


Fig. 12

**FIG. 13****FIG. 14**

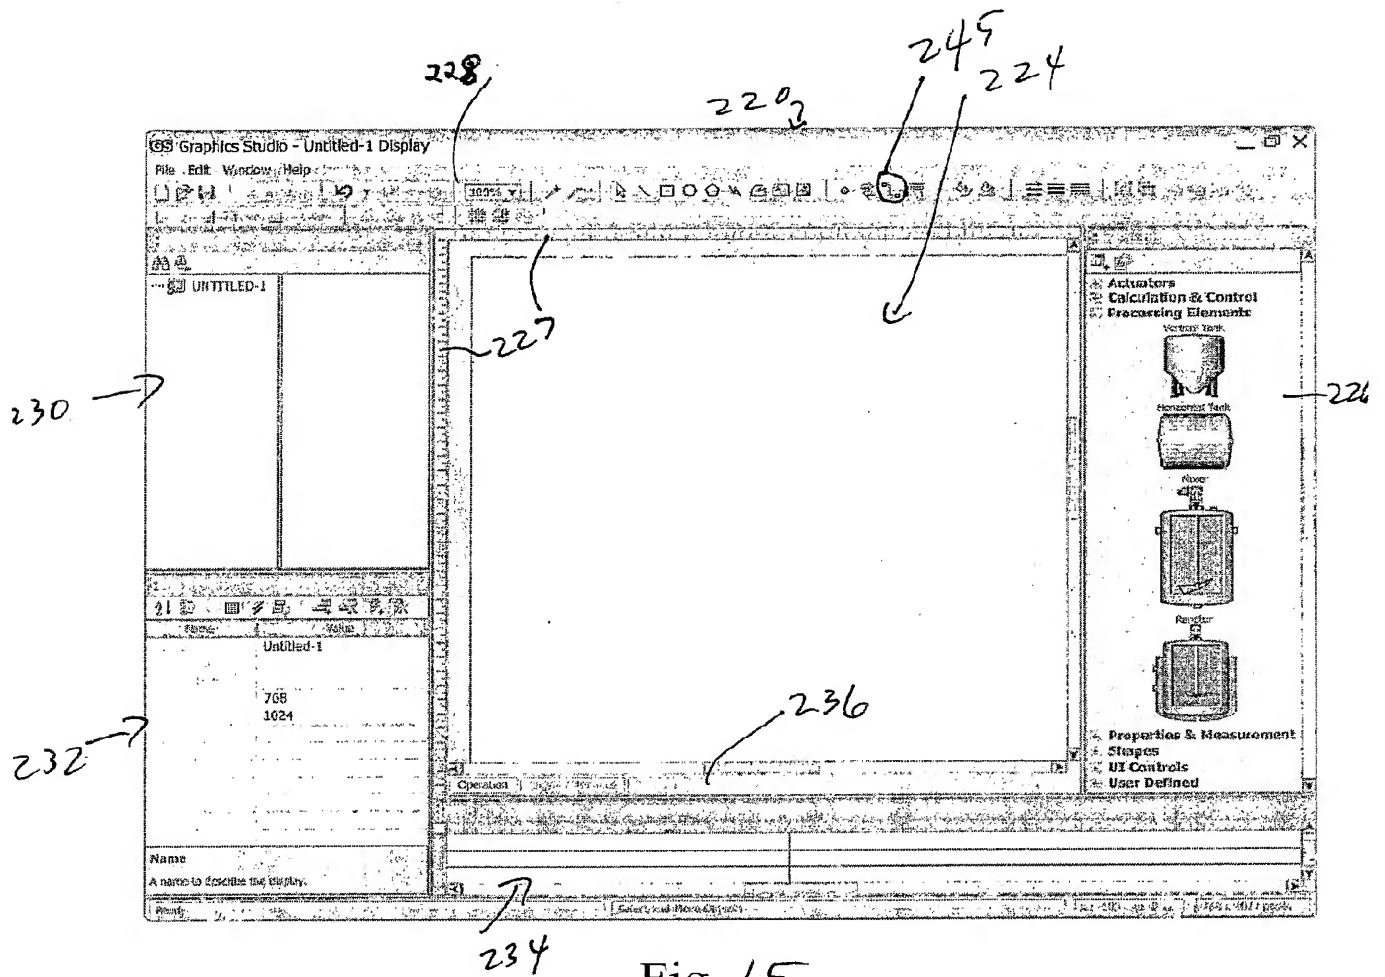


Fig. 15

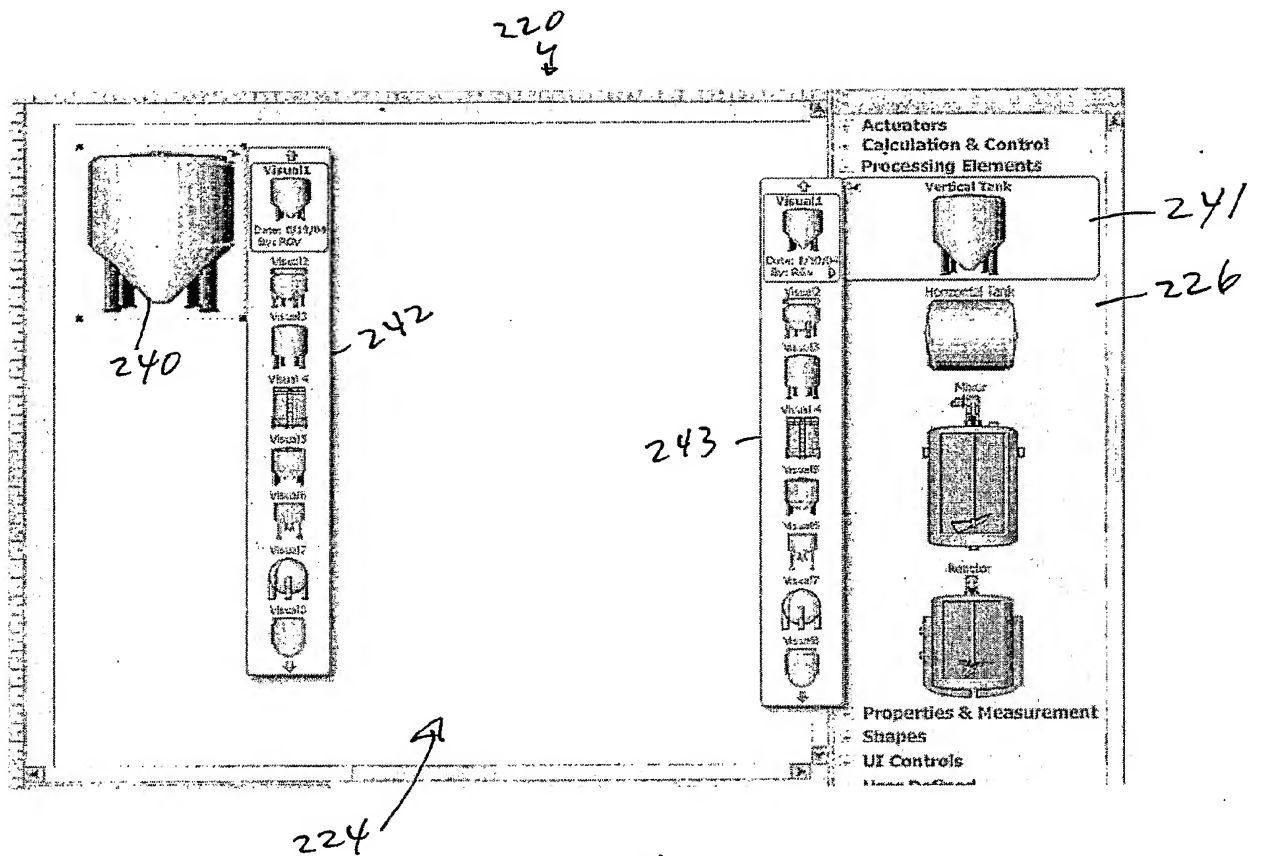


Fig. 16

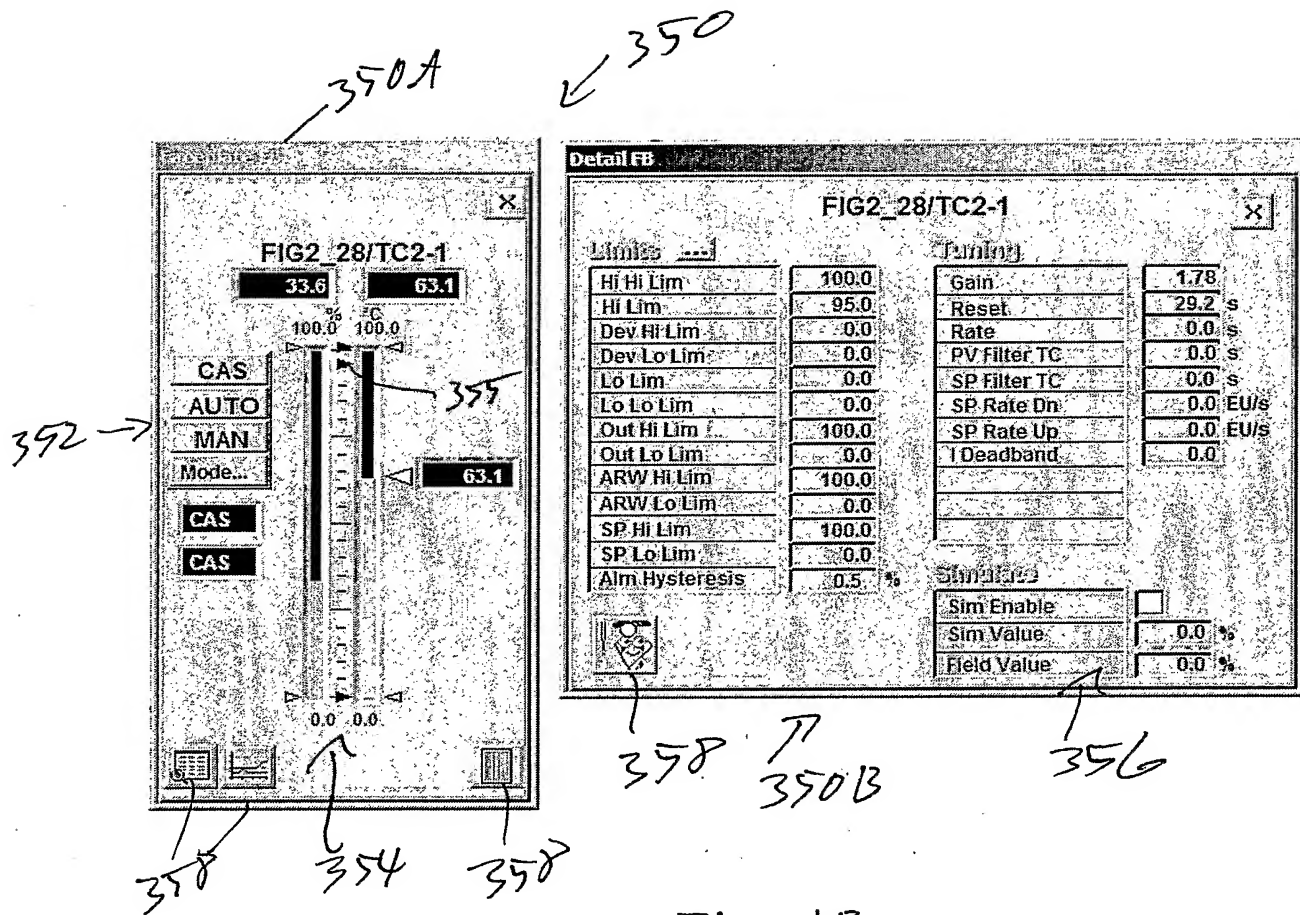


Fig. 18

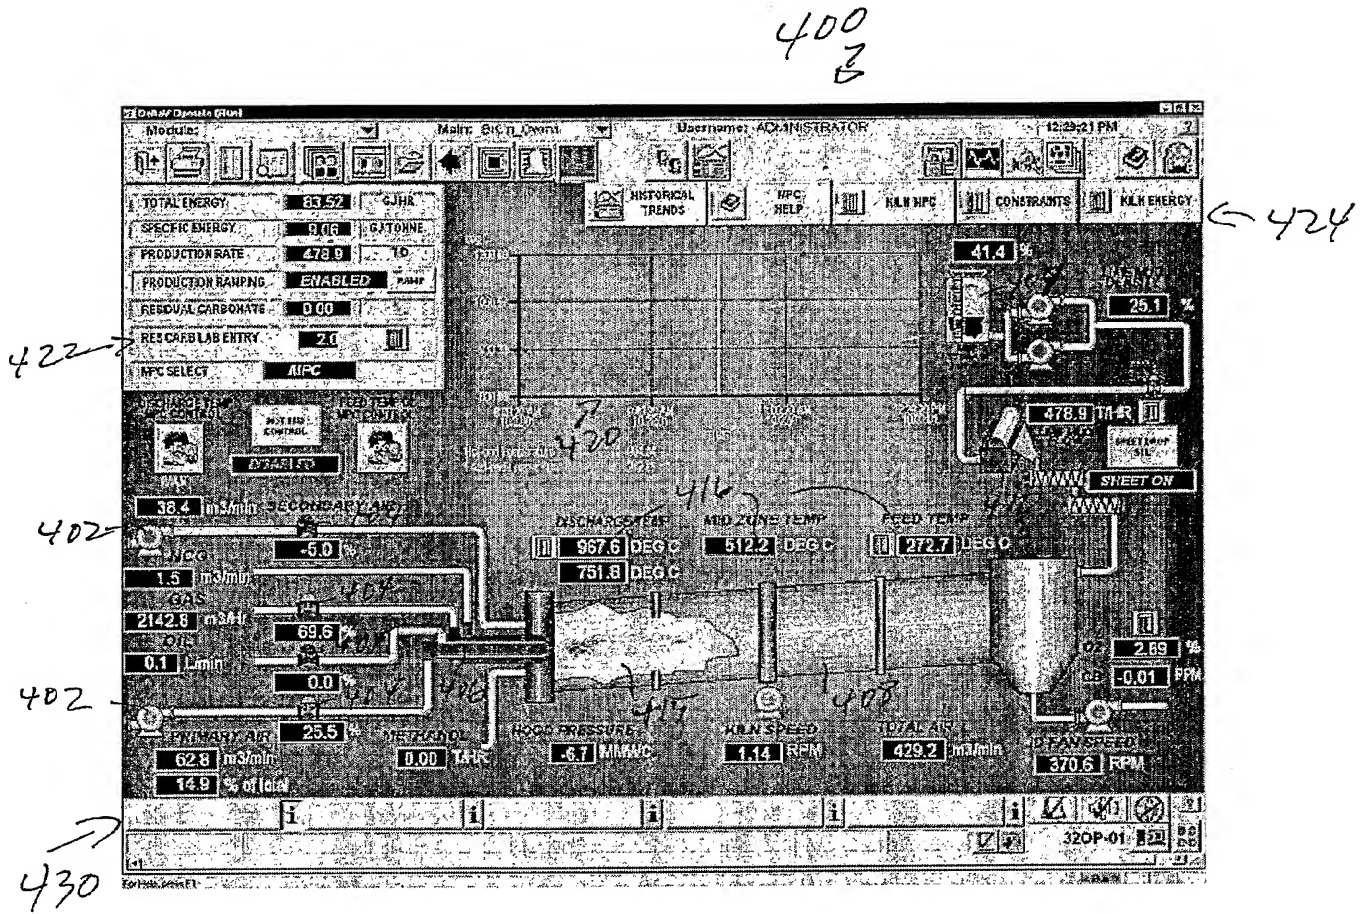


Fig. 19

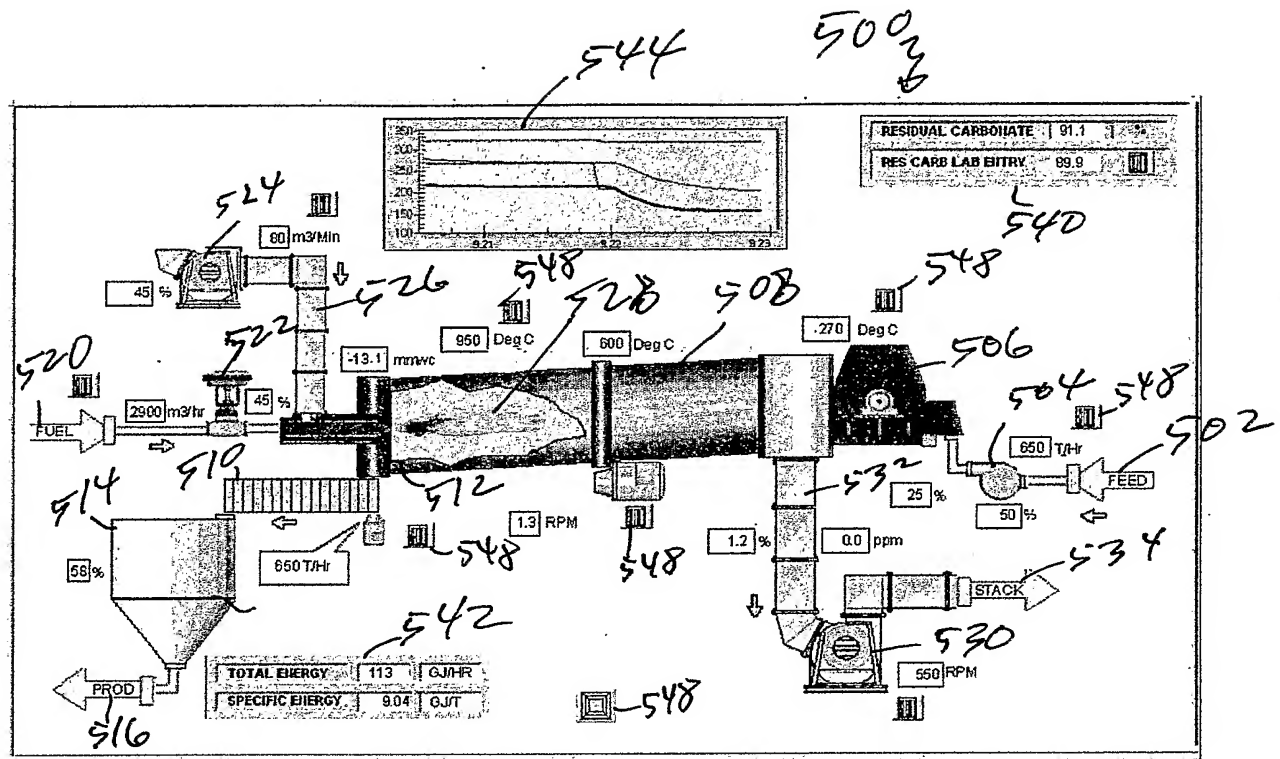
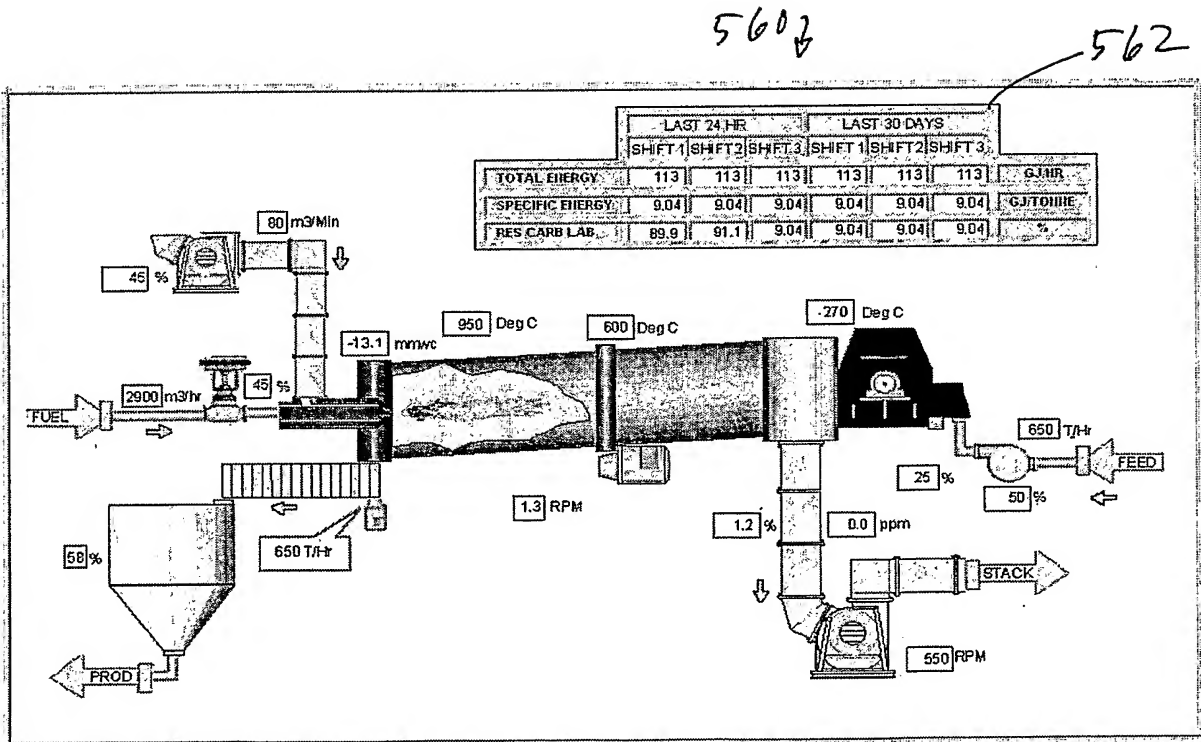
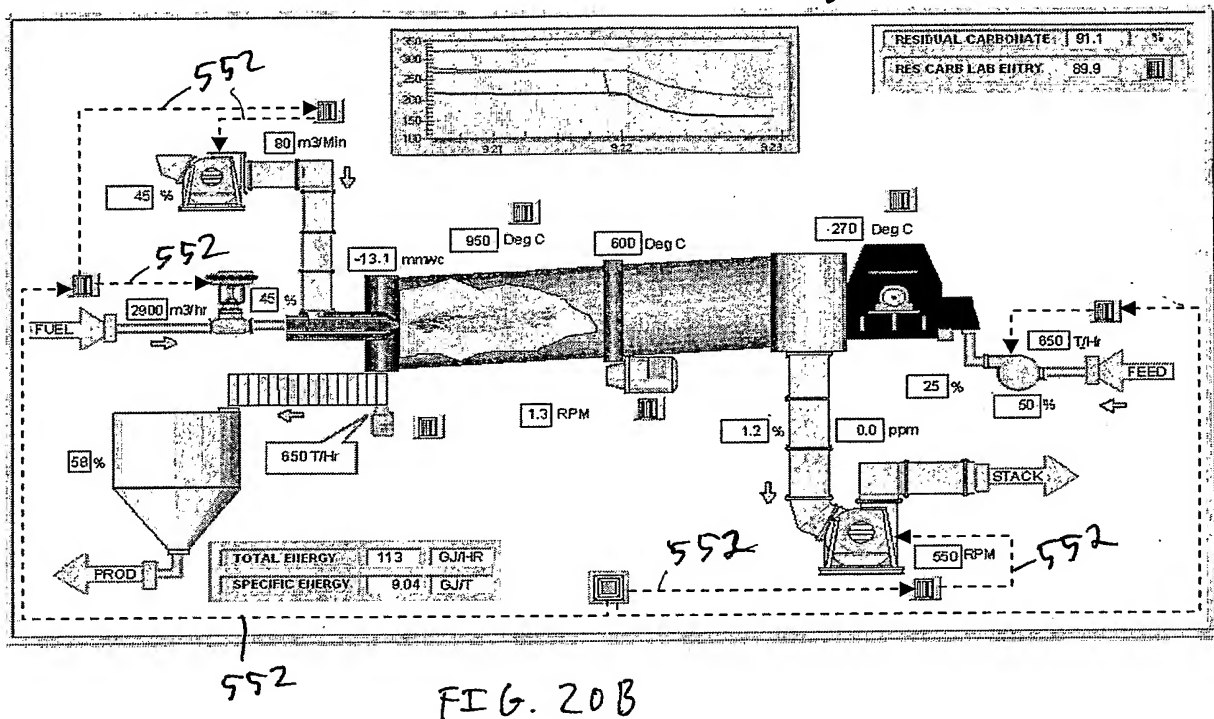


FIG. 20A



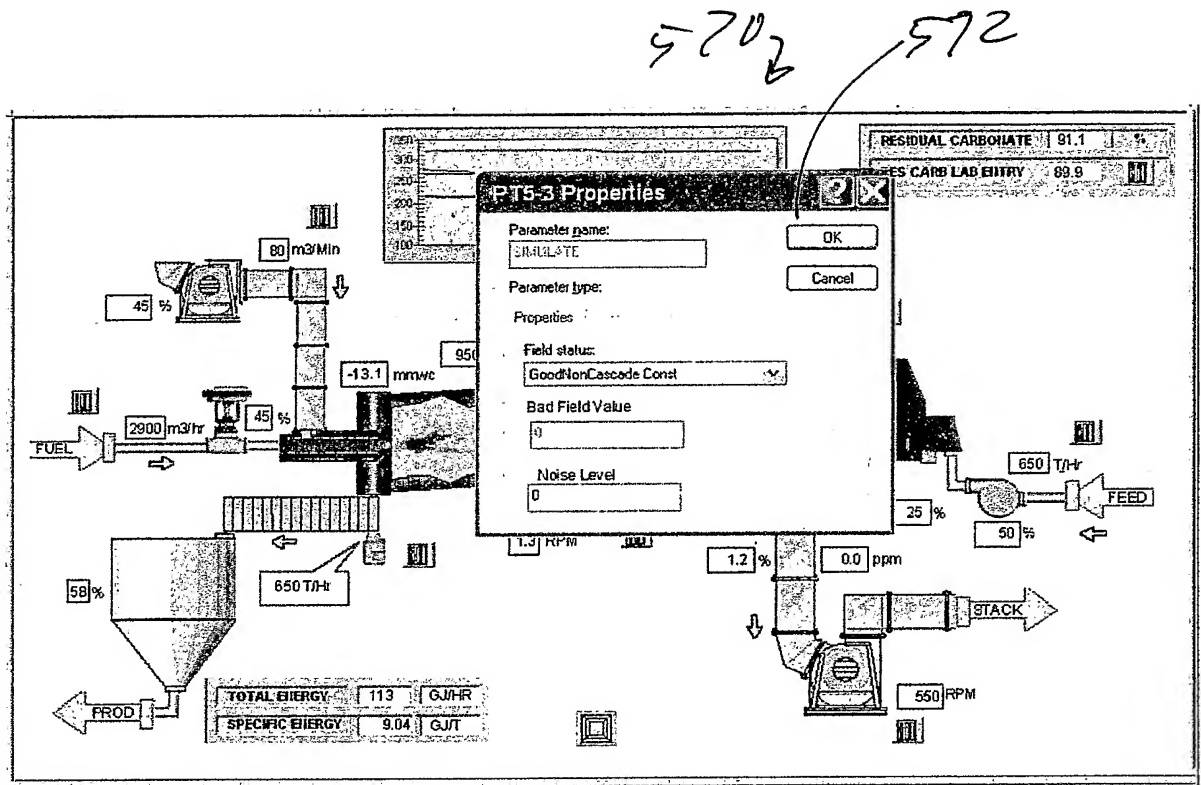


FIG. 20D

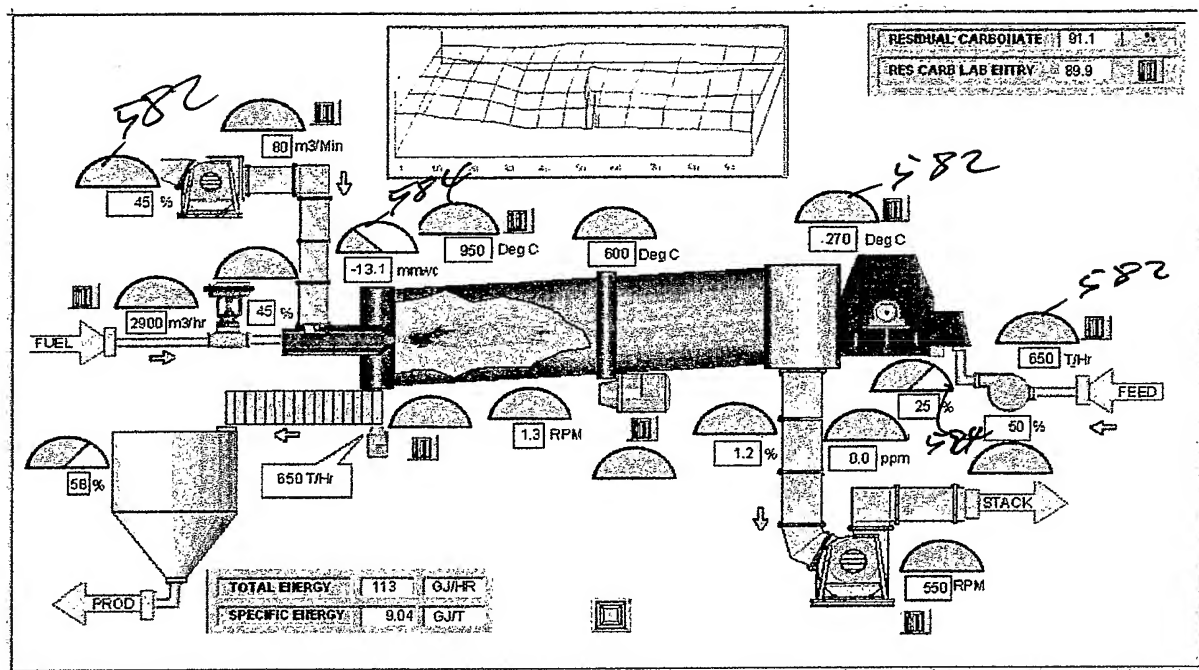


FIG. 20F

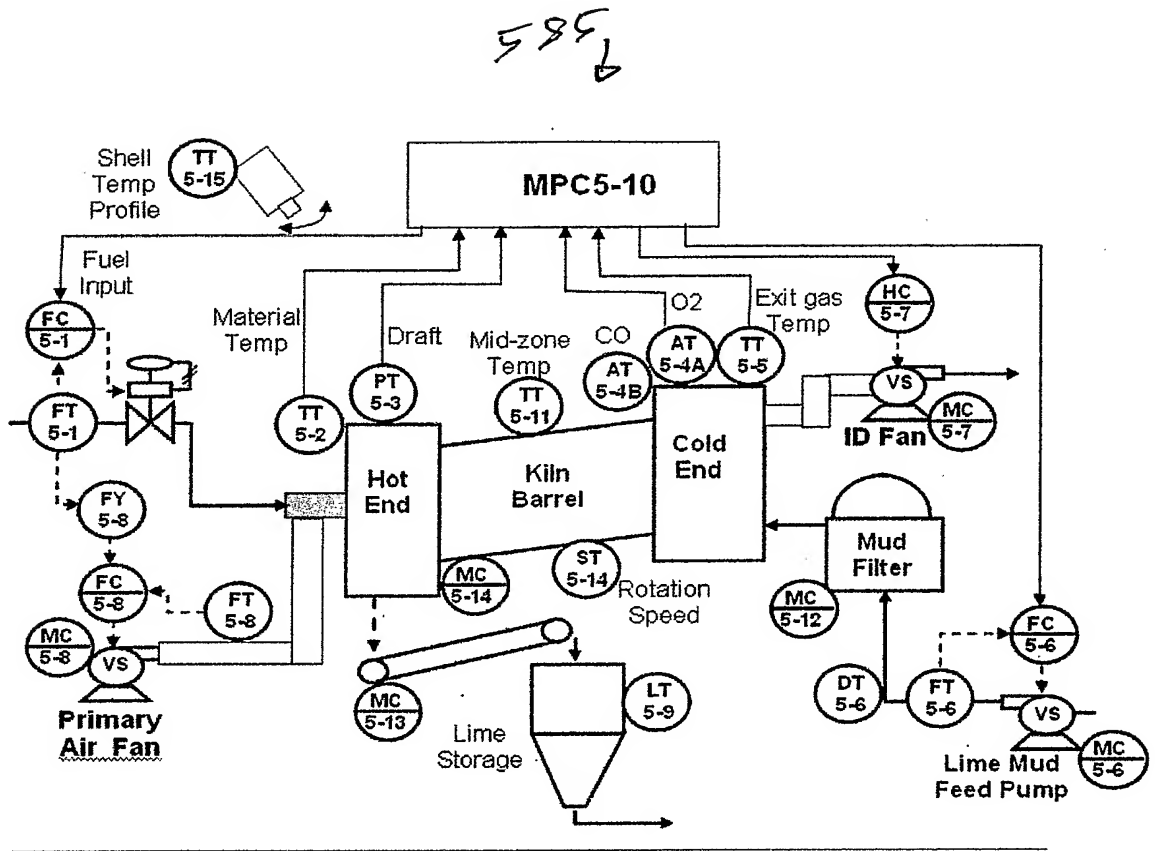


FIG. 21A

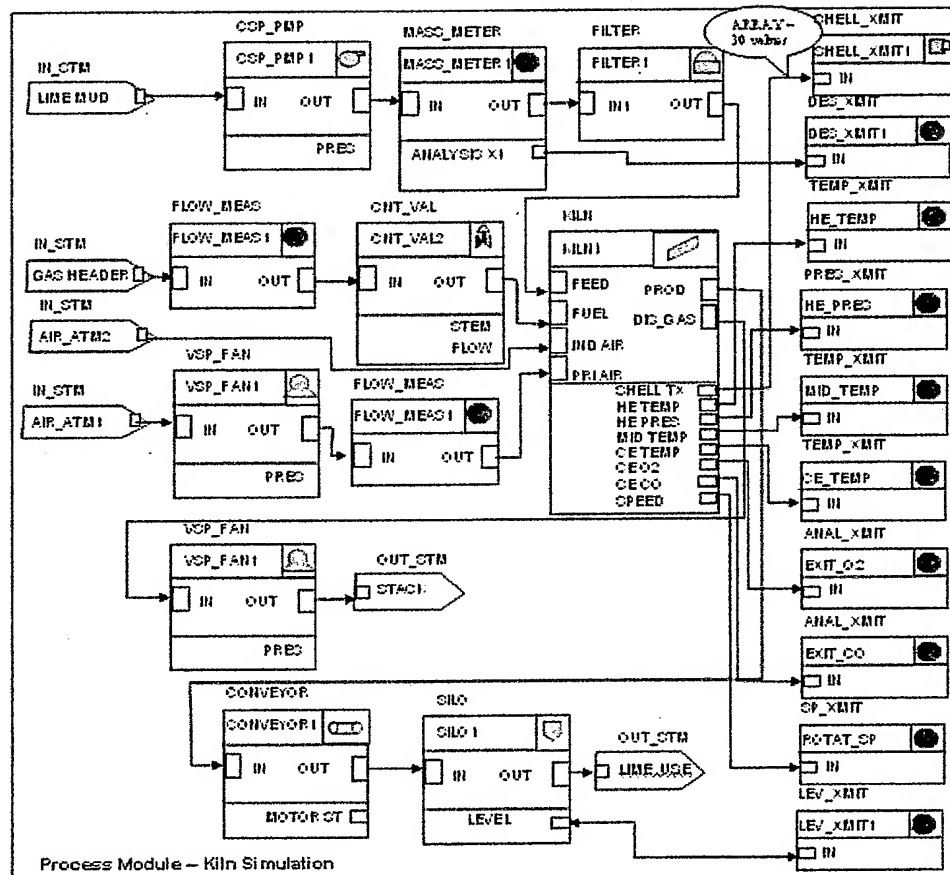


FIG. 21 B

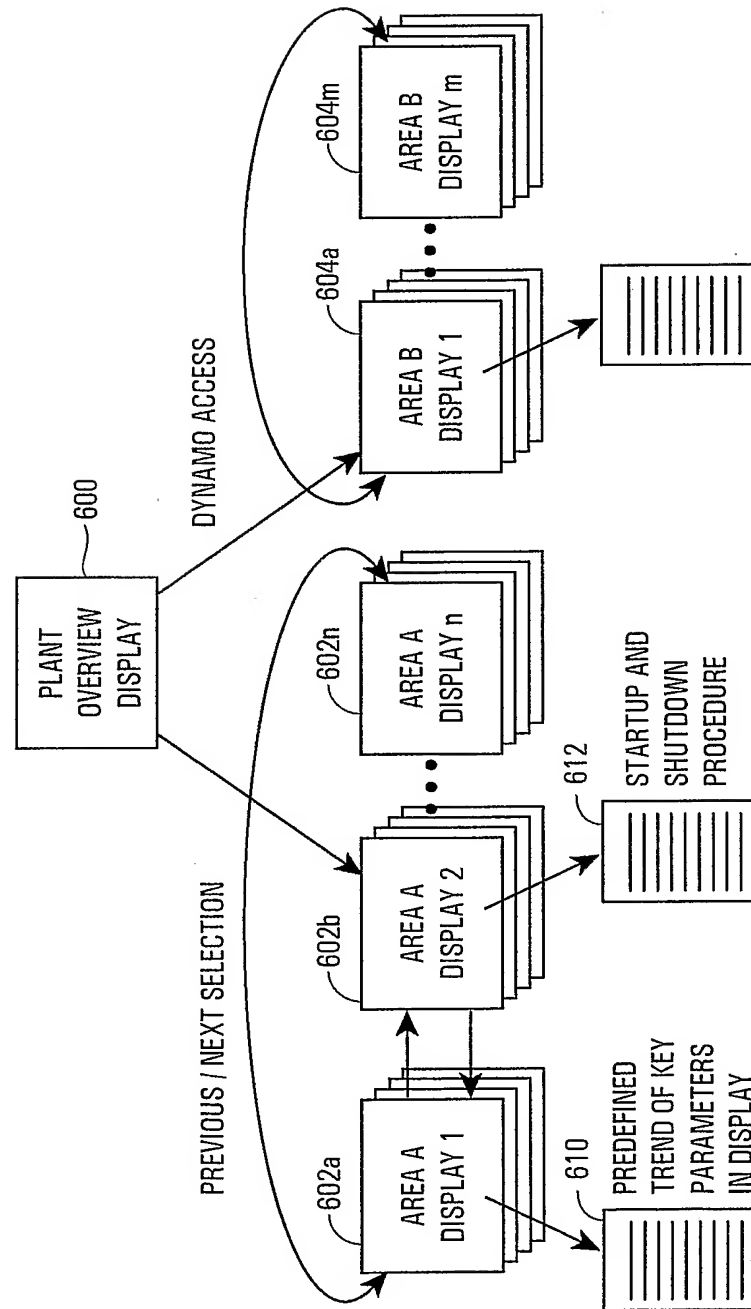


FIG. 22

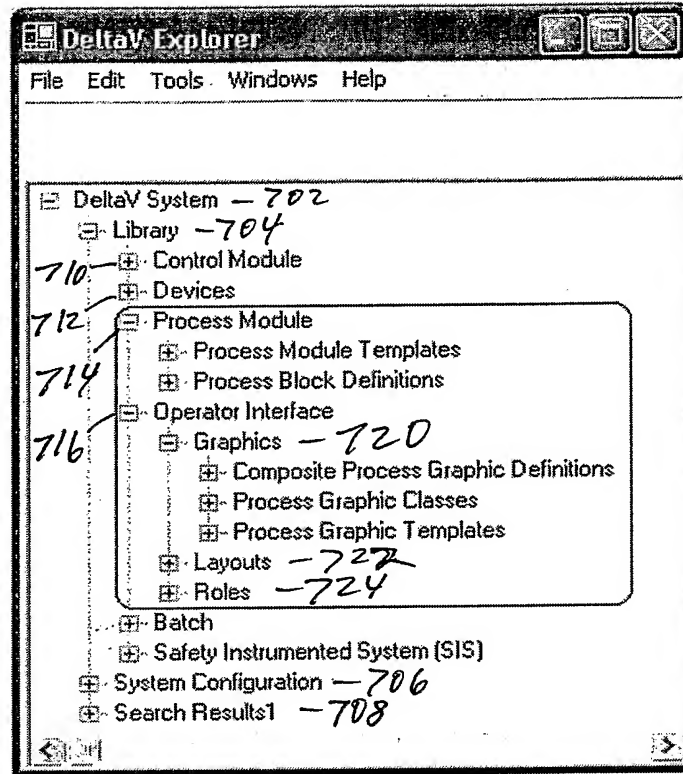


Fig. 23

800

Selected Object	Direction	Object	Type
[-] Display1	used in	Plant Area: Area_A	Primary Display
	used in	Control Module: Mod1	Primary Display
	Assigned to	Operator Station: Oper1	
[-] Display2	used in	Plant Area: Area_B	Detail Display
	used in	Control Module: Mod2	Detail Display
	Assigned to	AppStation: Wks1	

Fig. 25

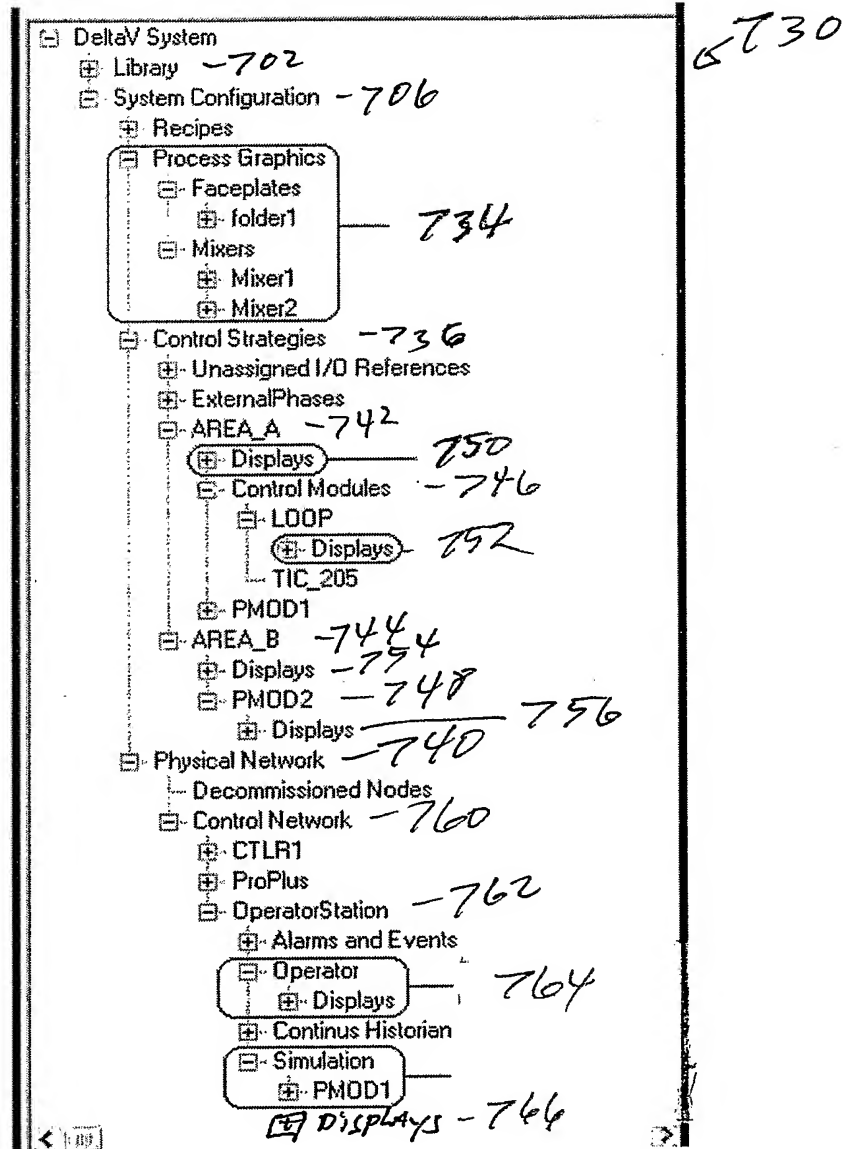


Fig. 24